


**CASE STUDY: - WNS GLOBAL SERVICES PVT. LTD.**

Re-known company in IT. We have installed more than 5000 Kva Powerwin™-Power Saver in WNS on PAN India basis.

In WNS, we have received 17% saving in Energy/Power. We have noted 8-days data before and after installation of Powerwin™-Power Saver.

Pl see graphical comparison for Power consumption before and after installation of Powerwin™-Power Saver for **Mix (Lighting plus Air-conditioner plus computers) Type of load.**

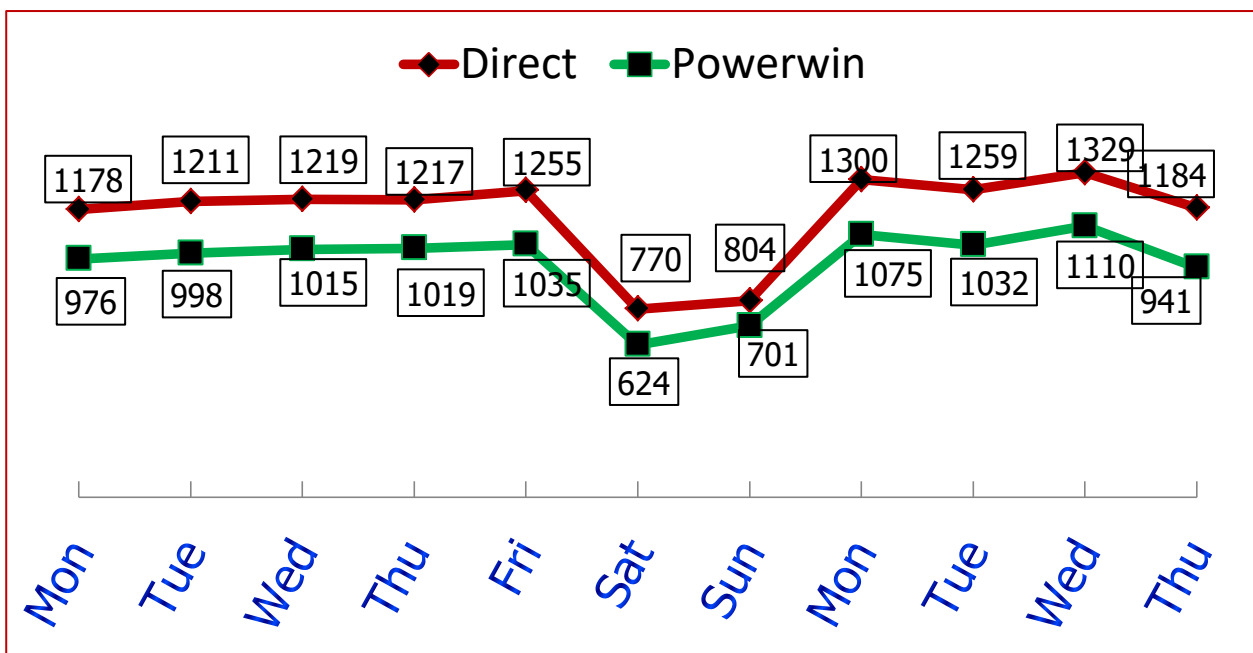

**%Saving Calculations:**

Total Avg. Unit consumption in Direct Mode : 1156.90

Total Avg. Unit consumption in Powerwin Mode : 956.90

Difference : 200.00

$$\begin{aligned}
 \% \text{ Energy Saving} &= \frac{(\text{Direct Consumption} - \text{Saving Consumption}) \times 100}{\text{Direct Consumption}} \\
 &= \frac{(1156.90 - 956.90) \times 100}{1156.90} \\
 &= \mathbf{17.28\%}
 \end{aligned}$$